



# DIAGRAM A

GAS METER CLEARANCES TO FINAL GRADE  
(250 METER SHOWN)

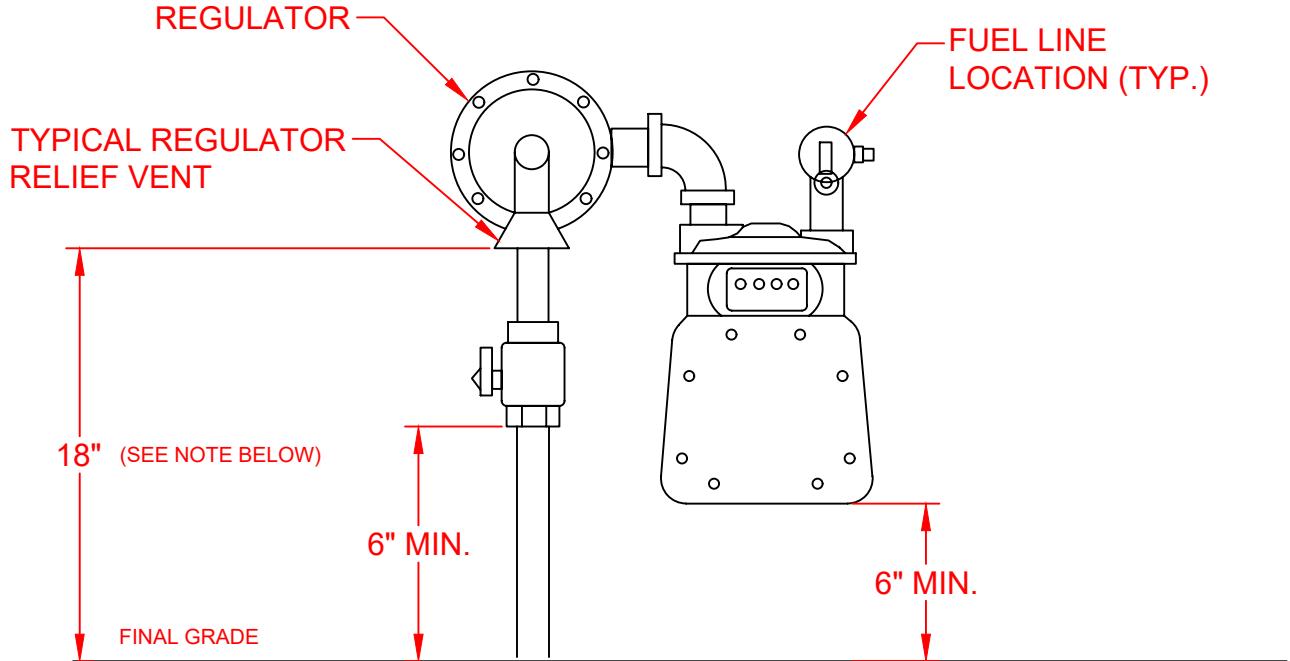

**NOTE:**

THE STANDARD INSTALLATION HEIGHT OF THE REGULATOR VENT IS APPROXIMATELY 28" FROM FINAL GRADE. HOWEVER, IF LOCAL CONDITIONS PREVENT THE STANDARD INSTALLATION, THE HEIGHT, WITH PRIOR SUPERVISORY APPROVAL, CAN BE REDUCED FOR THE INSTALLATION. UNDER NO CIRCUMSTANCES CAN THE HEIGHT BE REDUCED TO LESS THAN 18".



						DRAWN <b>JNM</b>			UNITIL GAS STANDARDS (ME) GAS METER SET ASSEMBLIES INSTALLATION REQUIREMENTS			
						CHECKED <b>CL</b>						
						APPROVED <b>CL</b>						
REV.	DESCRIPTION	BY	DATE	CHK	APR	REVISIONS		SCALE	DATE	SHEET	DRAWING NO.	
								N/A	4/3/12	1 OF 6	UAYMX002	


# DIAGRAM B

## MEASURING AROUND A BUILDING CORNER REGULATOR CLEARANCE

### OUTSIDE CORNERS:

- CLEARANCE DISTANCES FROM THE REGULATOR RELIEF VENT OR METER SET ASSEMBLY TO THE FEATURE(S) MUST BE MAINTAINED IN ACCORDANCE WITH THE APPLICABLE IGNITION SOURCE/OPENING FEATURE CLEARANCE REQUIREMENT DIAGRAM. *MEASURE AS IF USING A STRING.*

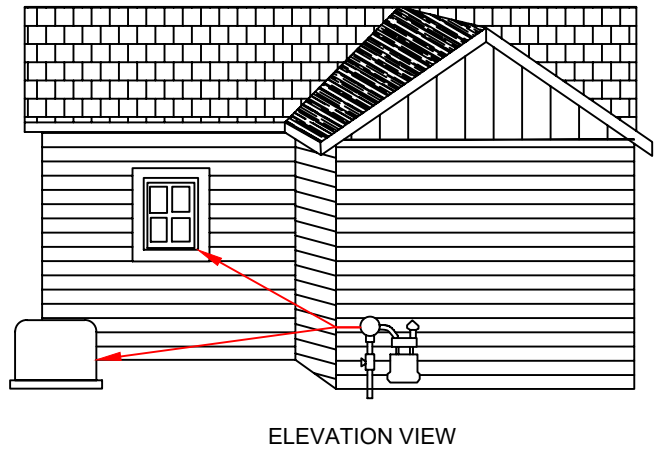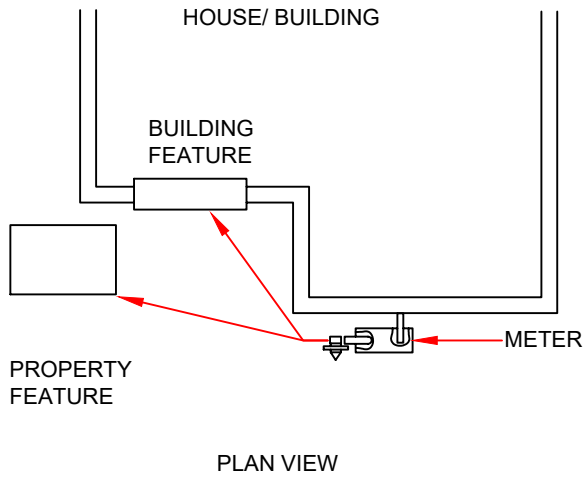



					DRAWN				UNITIL GAS STANDARDS (ME) GAS METER SET ASSEMBLIES INSTALLATION REQUIREMENTS					
					JNM									
					CHECKED CL									
					APPROVED		SCALE		DATE		SHEET		DRAWING NO.	
					CL		N/A		4/3/12		2 OF 6		UAYMX002	
REVISIONS														
REV.	DESCRIPTION	BY	DATE	CHK	APR									
-	REVISED NOT-TION	JEH	10/07/22											


# DIAGRAM C

## MEASURING AROUND A BUILDING CORNER REGULATOR CLEARANCE

### INSIDE CORNERS:

- CLEARANCE DISTANCES FROM THE REGULATOR RELIEF VENT OR METER SET ASSEMBLY TO THE FEATURE(S) MUST BE MAINTAINED IN ACCORDANCE WITH THE APPLICABLE IGNITION SOURCE/OPENING FEATURE CLEARANCE REQUIREMENT DIAGRAM. *MEASURE AS IF USING A STRING.*

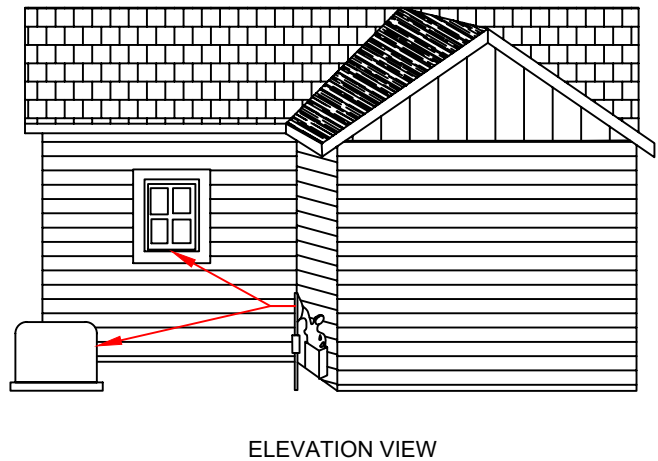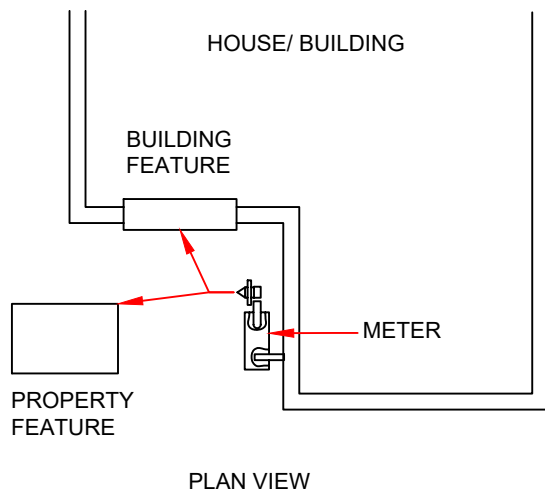

					DRAWN					
					JNM					
					CHECKED					
					CL	UNITIL GAS STANDARDS (ME)				
					APPROVED	GAS METER SET ASSEMBLIES				
					CL	INSTALLATION REQUIREMENTS				
REV.		DESCRIPTION	BY	DATE	CHK	APR	SCALE	DATE	SHEET	DRAWING NO.
-		REVISED NOT-TION	JEH	10/07/22			N/A	4/3/12	3 OF 6	UAYMX002
REVISIONS										




# DIAGRAM H


## REGULATOR RELIEF VENT CLEARANCES FROM FEATURES




APPLIANCE COMBUSTION  
AIR INTAKE VENT OPENING




APPLIANCE EXHAUST  
VENT OPENING




ELECTRIC METER




DISCONNECT




WALL SWITCH

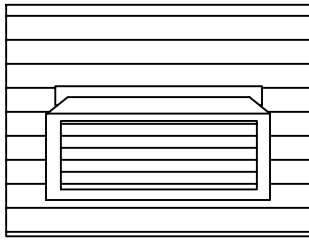


WALL MOUNTED  
AIR CONDITIONER

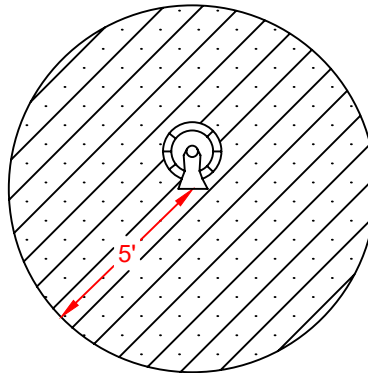


NO FEATURES TO BE PLACED  
WITHIN TOLERANCE ZONE  
(CROSS-HATCHED AREA)




ELECTRIC OUTLET





AIR CONDITIONER  
OR HEAT PUMP



GENERATOR OR  
TRANSFORMER



OPEN FLAME OR  
PERMANENT BBQ

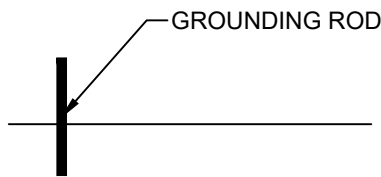

INCINERATOR

REV.	DESCRIPTION	BY	DATE	CHK	APR
REVISIONS					

DRAWN  
JNM  
CHECKED  
CL  
APPROVED  
CL



UNITIL GAS STANDARDS (ME)  
GAS METER SET ASSEMBLIES  
IGNITION FEATURES

SCALE N/A	DATE 11/03/22	SHEET 5 OF 6	DRAWING NO. UAYMX002
--------------	------------------	-----------------	-------------------------

